

Protameen Chemicals, Inc.
375 Minnissink Road
Totowa, NJ 07511 USA

Phone: (973) 256-4374

Fax: (973) 256-6764

Page 1 of 2

BL #: 87306

PO #: PO017830

Certificate Of Analysis

Product: METHYL PARABEN NF

Lot #: LG0711

Customer Code: 1-MENTHPARA

Manufacture Date: 7/7/2024

Retest Date: 7/6/2029

Test/Property	Specification	Result
Identification - IR	Conforms to USP/NF	Conforms to USP/NF
Melting Range (deg. C)	125.00 - 128.00	127.00
Acidity	0.00 - 0.10	0.01
Related Substances	p-Hydroxybenzoic Acid 0.5% MAX Unspecified Impurities 0.5% MAX Total Impurities 1.0% MAX	Pass
Residual Solvent (ppm)	3000 MAX (Methanol)	Less than 10
Residue on Ignition	0.10 % MAX	0.00
Sulfated Ash %	0.00 - 0.10	0.00
Appearance	White crystalline powder	Pass
Appearance of Solution	Conforms to EP/BP	Pass
Assay (%)	98.00 - 102.00	100.00
Color of Solution	Conforms to USP/NF	Pass

Joe Giovanniello
Technical Manager

Approved By: _____


Joe

Approval Date: 4/30/2025

Spec ID: 670-BOX

Spec Revision Date: 10/24/2016 11:14:02 AM

Manufactured by UENO Fine Chemicals Ltd.
1-4 Kasumi, Yokkaichi-shi MIE 510-0011, Japan



Protameen Chemicals, Inc.
375 Minnisink Road
Totowa, NJ 07511 USA

Phone: (973) 256-4374

Fax: (973) 256-6764

Page 2 of 2

BL #: 87306

PO #: PO017830

Customer: DERMA RITE INDUSTRIES
LLC

Address: DERMARITE IND.
7777 WEST SIDE AVENUE
NORTH BERGEN, NJ 07047

Certificate Of Analysis

Product: METHYL PARABEN NF

Lot #: LG0711

Customer Code: 1-MENTHPARA

Manufacture Date: 7/7/2024

Retest Date: 7/6/2029

Test/Property

Specification

Result

Joe Giovanniello
Technical Manager

Approved By: _____

Approval Date: 4/30/2025

Joe


Spec ID: 670-BOX

Spec Revision Date: 10/24/2016 11:14:02 AM

Manufactured by UENO Fine Chemicals Ltd.
1-4 Kasumi, Yokkaichi-shi MIE 510-0011, Japan

Analyst
Date

Christopher Hooper
Thursday, May 29, 2025 2:15 PM

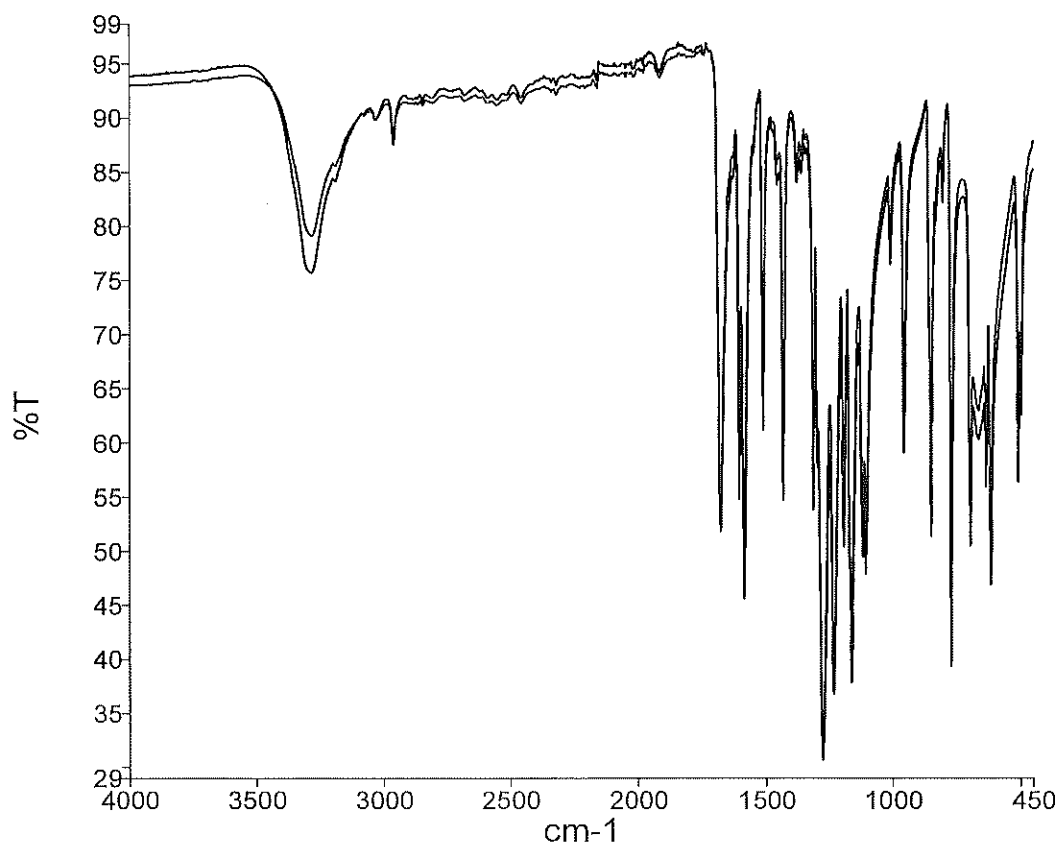


———— 1-MENTHPARA_R250362 Sample 005 By chooper Date Thursday, May 29 2025
- - - - - 1-MENTHPARA_R230026 Sample 008 By chooper Date Wednesday, January 18 2023

CH 05/29/25

Source Spectra			
Sample Name	Best Hit	Correlation	Pass / Fail
1-MENTHPARA_R250362	C:\pel_data\spectra\STANDARDS 2023\1-MENTHPARA_R230026.sp	0.998122	Pass

Compared References		
Sample Name	Correlation	Pass / Fail
C:\pel_data\spectra\STANDARDS 2023\1-MENTHPARA_R230026.sp	0.998122	Pass

Analyst Christopher Hooper
Date Thursday, May 29, 2025 2:15 PM

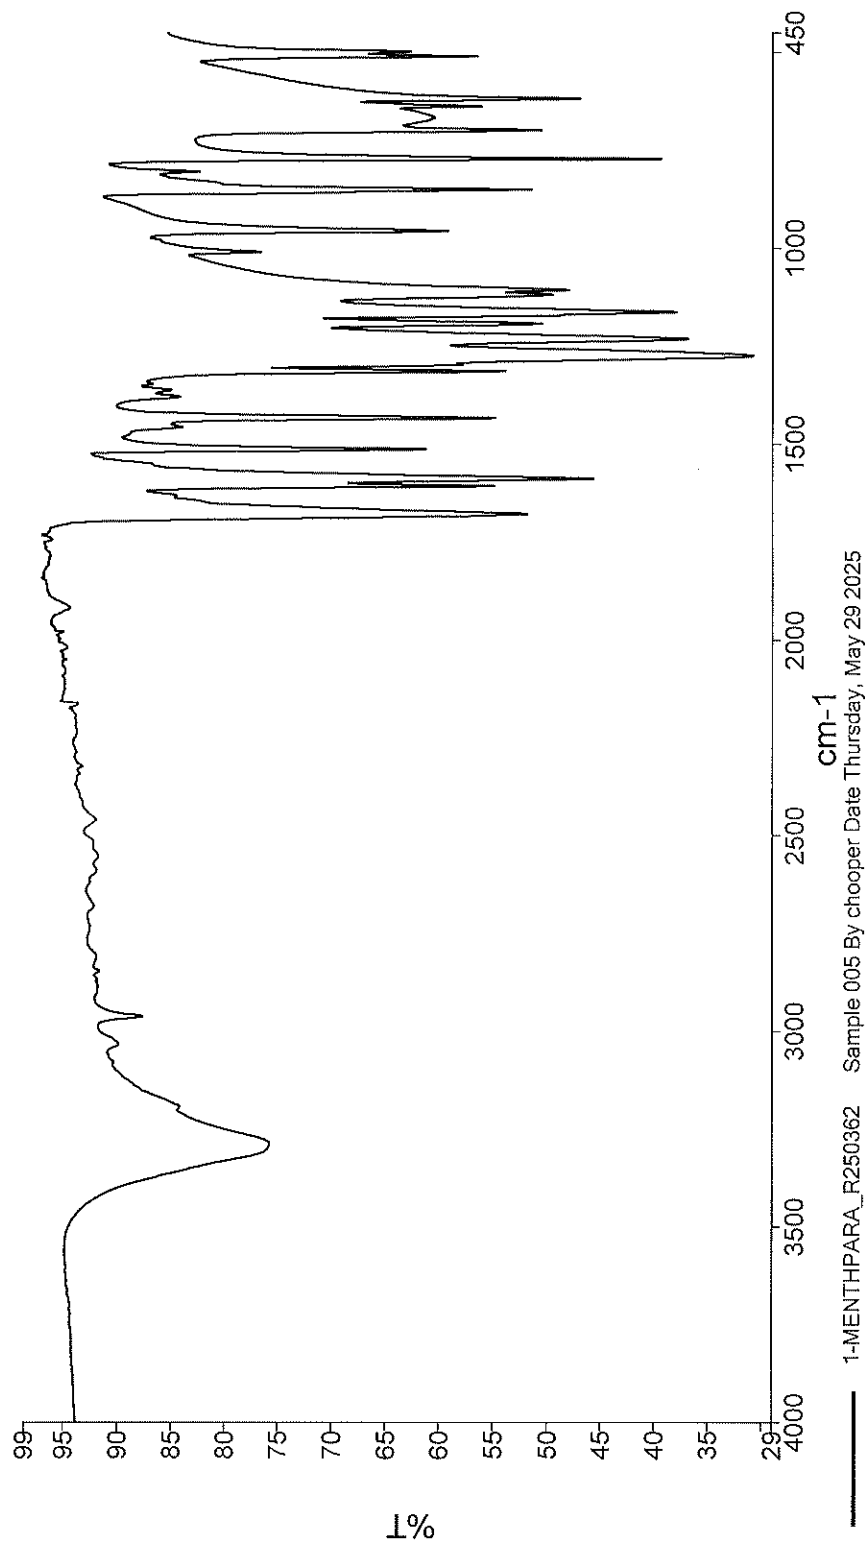

1-MENTHPARA_R250362 Sample 005 By chooper Date Thursday, May 29 2025

CH 05/29/25